



2310067B10Rik (IR00002681 / E91 ICS internal reference)
mouse line genotyping protocol

Table of contents

| | |
|---|---|
| Table of contents | 1 |
| 1. Genotyping protocol and data | 2 |
| 1.1. Genotyping strategy | 2 |
| 1.2. PCR protocol | 3 |
| 1.3. Picture of genotyping with various alleles | 4 |
| 2. Cre and Flp genotyping method | 5 |
| 2.1. Cre genotyping | 5 |
| 2.2. Flp genotyping | 6 |

For any question, please contact:

Mouse Clinical Institute – Institut Clinique de la Souris (ICS)

ICS genotyping service

1 rue Laurent Fries, BP 10142

67404 Illkirch Cedex France

Email: genotyping@igbmc.u-strasbg.fr


This protocol has been validated by Karim Essabri.

1. Genotyping protocol and data

This section describes the condition used at the Mouse Clinical Institute (ICS) to genotype your **2310067B10Rik** Constitutive Knockout / Conditional Knockout (KO-cKO) project.

1.1. Genotyping strategy

The map below describes the position of the primers used for genotyping for each possible allele.

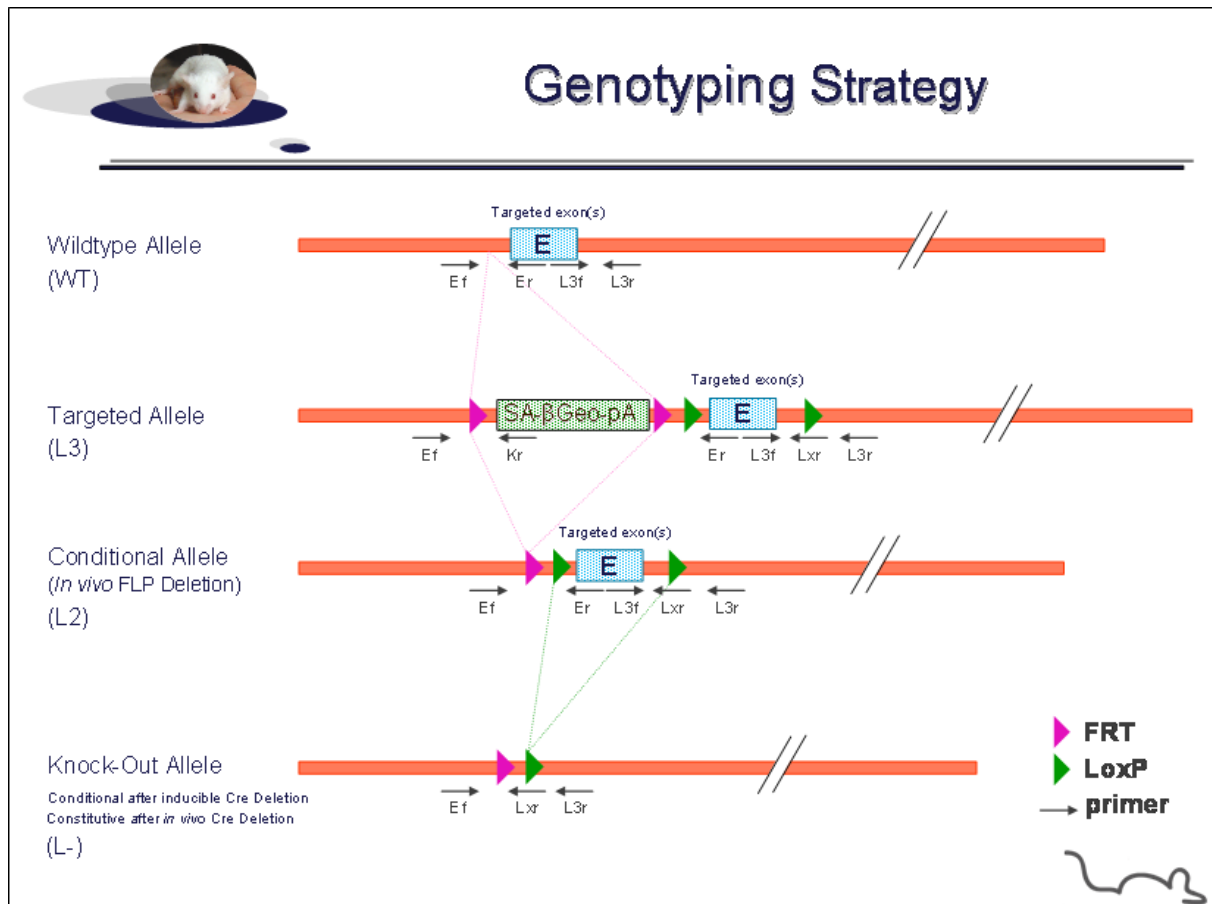

Sequence of primers used for genotyping

| Position | Primers | Sequence |
|------------------|---------|-----------------------------|
| Ef | 4755 | ACCATGTTGCTGGCACC |
| Ef ^r | 4756 | TCCATGCCATCCCTCCA |
| Er | 4761 | ATTCCAGCACTGTGGGGAG |
| Kr | 3209 | CCAACAGCTTCCCCACAACGG |
| L3f | 4757 | CCCTGCACTGGGCTTACAGAGATG |
| L3f ^r | 4759 | TCAGGGAAGGCACTGTTGAAAATATGG |
| L3r | 4758 | TGAGCCCTATGGGACTTGCGTT |
| L3r ^r | 4760 | TGGGACTTGCGTTTCTAGGGCTTAA |
| Lxr | 3254 | TTATCATTAATTGCGTTGCGCCATC |

². For a selected position, a second primer was designed



Genotyping protocol

2310067B10Rik (IR00002681 / E91 ICS internal reference)

PCR fragments expected size (bp):

| Region analyzed | Primers used | Position on the primer (see the map above) | Targeted allele (KO allele) (L3) | cKO allele (L2) | KO allele (L-) | WildType allele (WT) |
|---|--------------|--|----------------------------------|-----------------|----------------|----------------------|
| 5' part of the selection marker | 4755-3209 | Ef / Kr | 467 | --- | --- | --- |
| Presence of the distal loxP | 4757-4758 | L3f / L3r | 405 | 405 | --- | 496 |
| Distal loxP specific PCR | 4759-3254 | L3 ^f / Lxr | 473 | 473 | --- | --- |
| Excision of the selection marker | 4755-4761 | Ef / Er | 7409* | 505 | --- | 417 |
| Excision(s) of the floxed exon(s), i.e. knock out | 4756-4760 | Ef ² / L3r ² | 7778* | 874* | 234** | 877** |

* This PCR product will not be observed using our PCR genotyping conditions (see description below)

** This PCR is only verified if mice are generated

--- No Amplicon should be obtained

1.2. PCR protocol

This section describes the composition of the mix and cycling conditions used for genotyping.

Reagents:

-10x Buffer (Roche)
 -dNTPs 10mM (Amersham Biosciences)
 -Taq DNA Polymerase (Roche)
 -DNA (50ng/μl)
 -5' primer (100 μM)
 -3' primer (100 μM)
 -Sterile H₂O

Volume:

2.5μl
 0.5μl
 0.2μl
 3μl
 0.125μl
 0.125μl
 up to 25 μl

Cycling conditions:


| Temp | Time | #Cycles |
|------|------|---------|
| 94°C | 3min | 1 |
| 94°C | 1min | 2 |
| 62°C | 1min | |
| 72°C | 1min | |
| 94°C | 30s | 30 |
| 62°C | 30s | |
| 72°C | 30s | |
| 72°C | 3min | 1 |
| 4°C | ∞ | |

NB: These PCR conditions have been optimized for high-throughput genotyping. Adaptation to small-scale may be required.

1.3. Picture of genotyping with various alleles

Analysis of PCR products pattern was not done by gel electrophoresis but using LabChip® 90 microfluidic apparatus. PCR products were run on the HT DNA 5K LabChip® 90 Assay Kit.

Representative genotyping picture

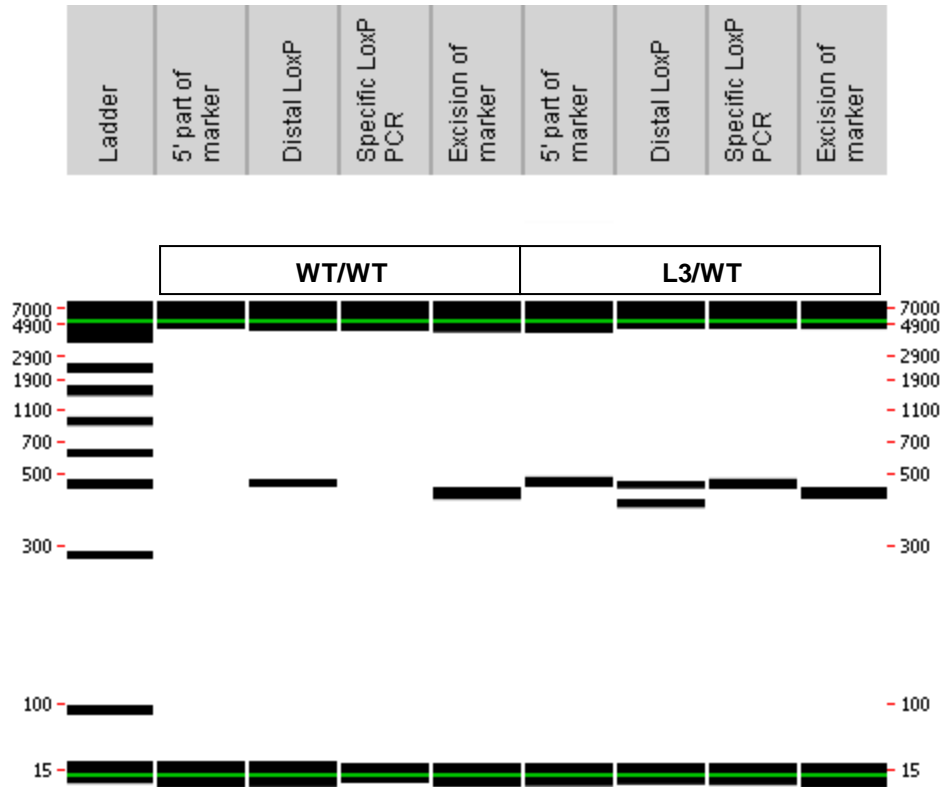


Note that as this technology is more sensitive than gel analysis, non specific signals and/or primer dimers may be visible on the picture.

2. Cre and Flp genotyping method

The protocol used to segregate the cre and/or flp transgene is indicated below.

2.1. Cre genotyping

Schematic representation of the genotyping strategy

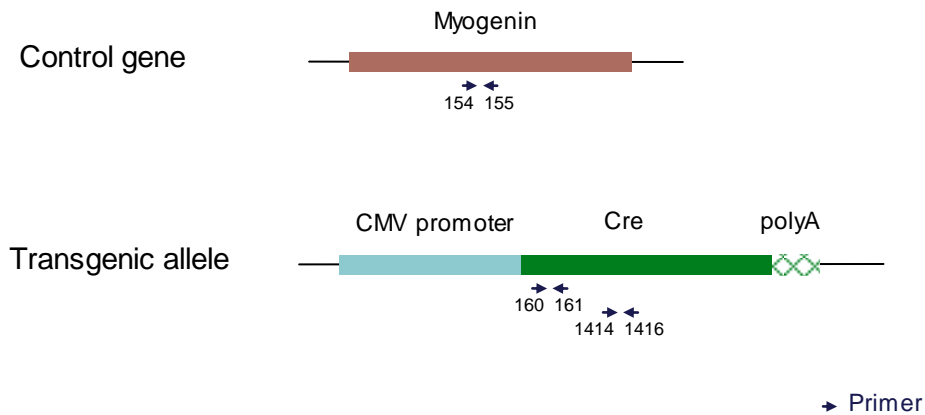

Sequence of primers used for genotyping

| Primers | Sequence |
|---------|---------------------------|
| 154 | ACTCCCTTACGTCCATCGTG |
| 155 | ACCCAGCCTGACAGACAATC |
| 160 | GAACCTGATGGACATGTTTCAGG |
| 161 | AGTGCGTTCGAACGCTAGAGCCTGT |
| 1414 | CGTACTGACGGTGGGAGAAAT |
| 1416 | CCCGGCAAAACAGGTAGTTA |

PCR fragments expected size (bp):

| Primer pair | 160-161 | 1414-1416 | 154-155 |
|-----------------|--------------------------|-------------------------|-----------------------|
| Region analyzed | 5' part of Cre transgene | Middle of Cre transgene | Myogenin control gene |
| Control gene | / | / | 99 |
| Tg allele | 345 | 165 | / |


Cycling conditions:

| Temp | Time | #Cycles |
|------|------|------------------------------|
| 95°C | 3min | 1 |
| 95°C | 10s | 35 |
| 62°C | 20s | |
| 72°C | 20s | |
| 95°C | 5s | 1 (melting curve generation) |
| 62°C | 30s | |
| 72°C | 72s | |
| 37°C | 30s | 1 |
| 4°C | ∞ | |

NB: These PCR conditions have been optimized for high-throughput genotyping. Adaptation to small-scale may be required.

2.2. Flp genotyping

Schematic representation of the genotyping strategy

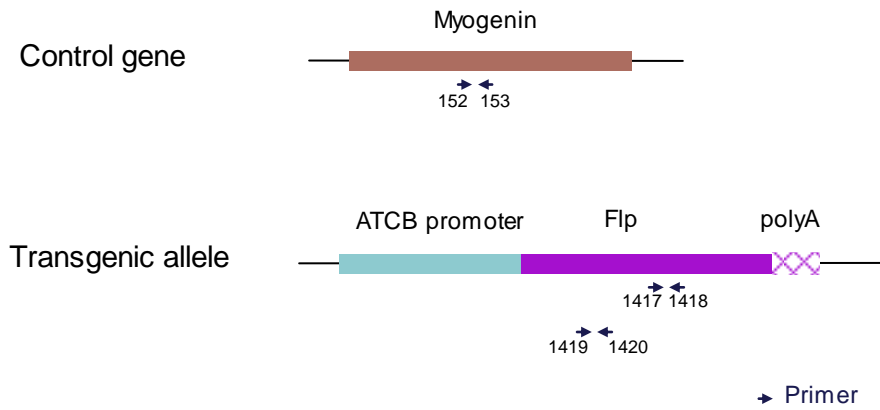

Sequence of primers used for genotyping

| Primers | Sequence |
|---------|----------------------|
| 152 | TTACGTCCATCGTGACAGC |
| 153 | TGGGCTGGGTGTTAGCCTTA |
| 1417 | TTCTTTAGCGCAAGGGGTAG |
| 1418 | GCTCCAATTTCCCACAACAT |
| 1419 | TGGGAAATTGGAGCGATAAG |
| 1420 | CTGCCACTCCTCAATTGGAT |

PCR fragments expected size (bp):

| Primer pair | 1417-1418 | 1419-1420 | 152-153 |
|-----------------|------------------------------|---------------------|-----------------------|
| Region analyzed | Middle part of Flp transgene | 5' of Flp transgene | Myogenin control gene |
| Control gene | / | / | 245 |
| Tg allele | 299 | 175 | / |

PCR protocol and cycling conditions are identical to those described in chapter 1.2