



Genotyping protocol

Agxt2l2

IR00001989 / E2

(ICS internal reference)

This report has been prepared by: **Valérie Rousseau, Engineer**
genotyping@igbmc.fr

This report has been validated by: **Sylvie Jacquot, PhD, Head of Genotyping Service**
33 (0)3 88 65 56 57
genotyping@igbmc.fr

The first version of this report was finalized the: 06 Feb 2012

For any question, please contact:

Institut Clinique de la Souris - ICS - Mouse Clinical Institute
1 rue Laurent Fries, BP 10142
67404 Illkirch Cedex, France
Email: genotyping@igbmc.fr
Web site: <http://www-mci.u-strasbg.fr/>

TABLE OF CONTENTS


Table of contents	2
1. Genotyping protocol and data	2
1.1. Genotyping strategy	2
1.2. PCR protocol	4
1.3. Picture of genotyping with various alleles	5
2. Cre and Flp genotyping method	6
2.1. Cre and Flp genotyping	6
2.2. PCR Protocol	7

1. Genotyping protocol and data

This section describes the condition used at the Mouse Clinical Institute (ICS) to genotype your **Agxt2l2** Constitutive Knockout / Conditional Knockout (KO-cKO) project.

1.1. Genotyping strategy

The map below describes the position of the primers used for genotyping for each possible allele.

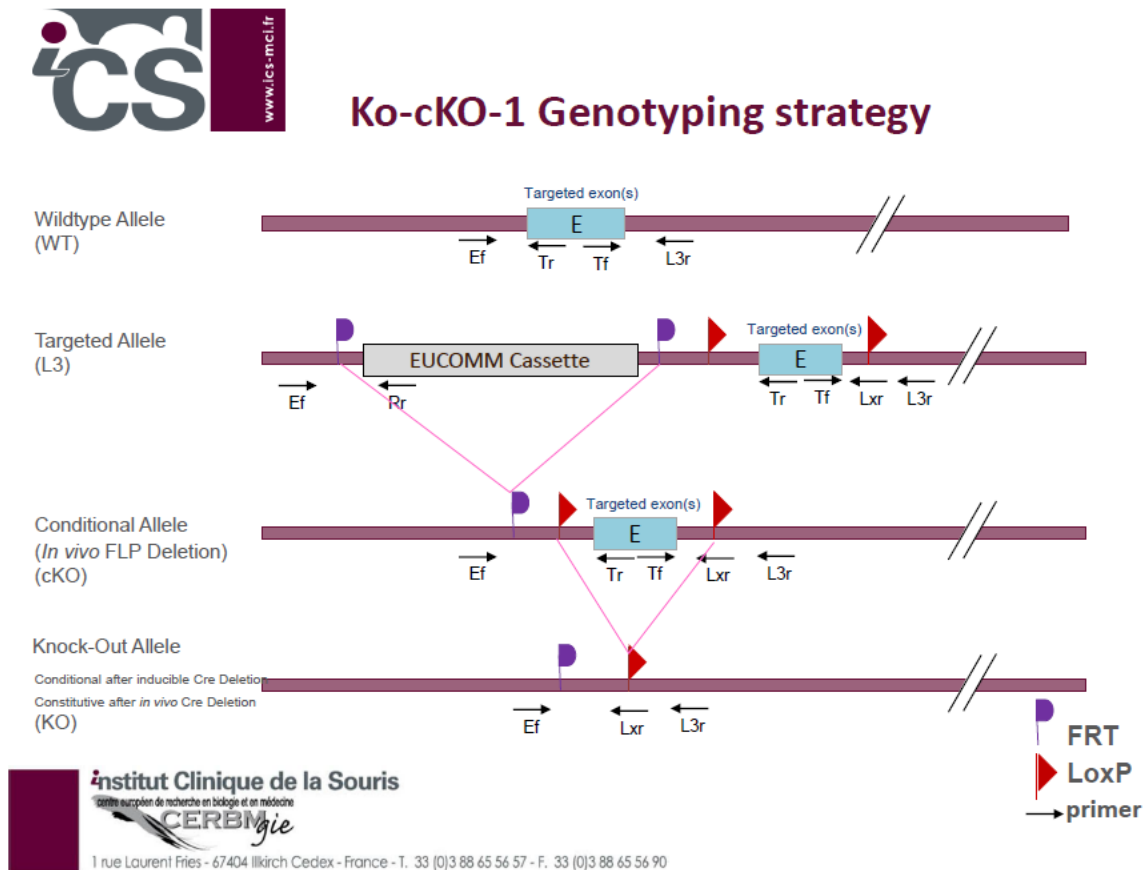

Sequence of primers used for genotyping:

Position	Primers	Sequence
Ef	3274	CTGAGATGCAGCTCCTAACAAGGG
Ef ²	3279	CCATTACTAACGGGGACAGCAAGG
Tr	3275	GTGGAACCTCCCTGCCTCCC
Rr	3277	CTCCTACATAGTTGGCAGTGTGGG
Tf	3271	CCCAGTCTTTGTGAAAAGACTCCACAC
Tf ²	3272	GCCATAGATCTGACTGATAGCCTGG
L3r	3273	CACACTACATTTGTGGTCATGGATGG
Lxr	3255	ACTGATGGCGAGCTCAGACCATAAC

PCR fragments expected size (bp):

Region analyzed	Primers used	Position on the primer (see the map above)	Targeted allele (KO allele) (L3)	cKO allele (L2)	KO allele (L-)	WildType allele (WT)
5' part of the selection marker	3279-3277	Ef ² / Rr	261	---	---	---
Presence of the distal loxP	3271-3273	Tf / L3r	171	171	---	157
Distal loxP specific PCR	3272-3255	Tf ² / Lxr	189	189	---	---
Excision of the selection marker	3274-3275	Ef / Tr	5754*	347	---	180
Excision of the floxed exon(s), i.e. knock out	3274-3273	Ef / L3r	6264*	857*	254**	676**

*: this PCR product will not be observed using our PCR genotyping conditions (see description below)

** : this PCR is only verified if mice are generated

---: no Amplicon should be obtained

1.2. PCR protocol

This section describes the composition of the mix and cycling conditions used for genotyping.

Reagents:	Volume:
- FastStart PCR Master (Roche)	7.5µl
- DNA (50ng/µl)	1.5µl
- 5' primer (100 µM)	0.06µl
- 3' primer (100 µM)	0.06µl
- Sterile H ₂ O	up to 15 µl

Cycling conditions:


Temp	Time	#Cycles
95°C	4min	1
94°C	30s	34
62°C	30s	
72°C	1min	
72°C	7min	1
20°C	5min	1

NB: These PCR conditions have been optimized for high-throughput genotyping. Adaptation to small-scale may be required.

1.3. Picture of genotyping with various alleles

Analysis of PCR products pattern was not done by gel electrophoresis but using LabChip® 90 microfluidic apparatus. PCR products were run on the HT DNA 5K LabChip® 90 Assay Kit.

Representative genotyping picture

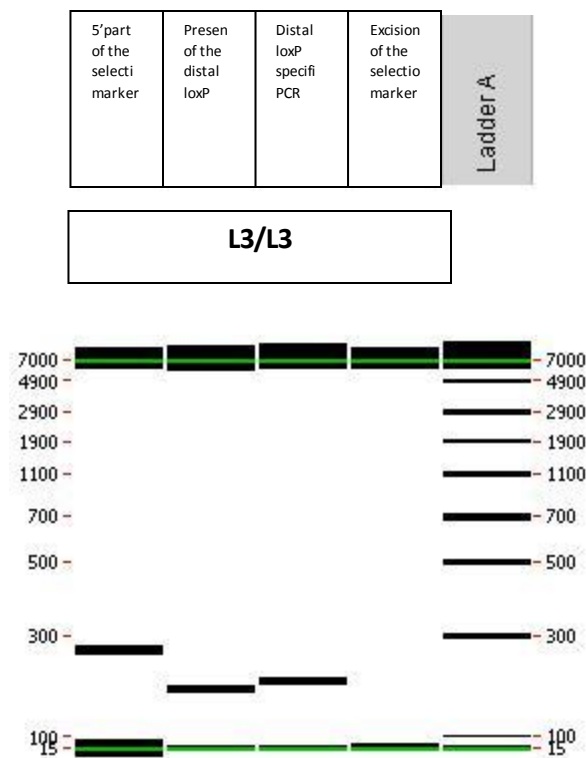

Note that as this technology is more sensitive than gel analysis, non specific signals and/or primer dimers may be visible on the picture.


2. Cre and Flp genotyping method

The protocol used to segregate the cre and/or flp transgene is indicated below.

Detection of cre transgene and flp transgene is done using a multiplex assay: primer pairs were designed for each gene and for a positive control (Cpxm1 gene).

2.1. Cre and Flp genotyping

Schematic representation of the genotyping strategy

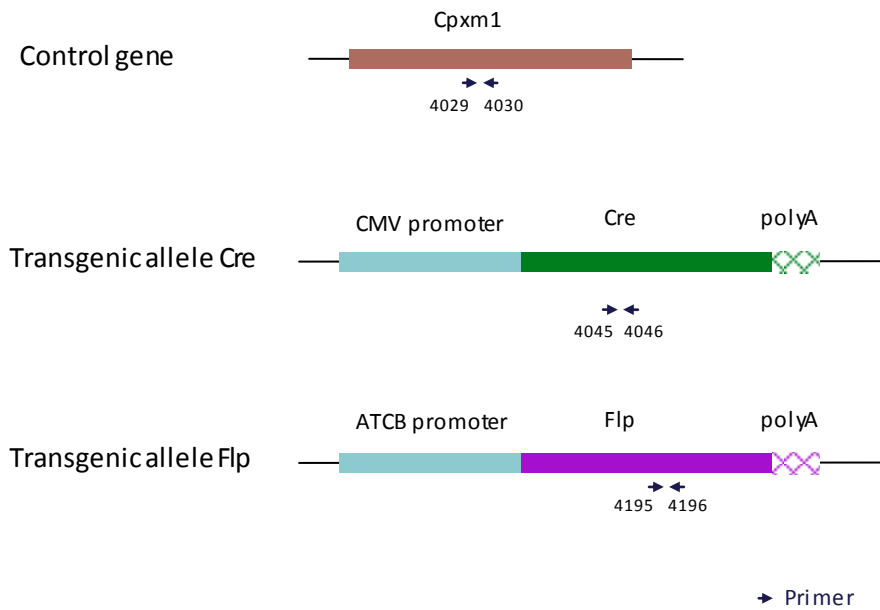

Sequence of primers used for genotyping:

Primers	Sequence
4029	ACTGGGATCTTCGAACTCTTTGGAC
4030	GATGTTGGGGCACTGCTCATTACC
4045	CCATCTGCCACCAGCCAG
4046	TCGCCATCTCCAGCAGG
4195	TCTTTAGCGCAAGGGGTAGGATCG
4196	GTCCTGGCCACGGCAGAAGC

PCR fragments expected size (bp):

Primer pair	4045-4046	4195-4196	4029-4030
Region analyzed	Middle part of Cre transgene	Middle part of Flp transgene	Cpxm1 control gene
Control gene	/	/	446
Tg allele	281	328	/

2.2. PCR Protocol

This section describes the composition of the mix and cycling conditions used for genotyping.

Reagents	Volume
FastStart PCR Master (Roche)	7.5 μ l
DNA (50ng/ μ l)	1.5 μ l
5' primer (100 μ M)	0.05 μ l
3' primer (100 μ M)	0.05 μ l
Sterile H ₂ O	up to 15 μ l

Cycling conditions are identical to those described in chapter 1.2