

Genotyping protocol

Project Klf12

(PHENOMIN-ICS reference IR00005379 / P5379)

This report has been **prepared** by: David MOULAERT

This report has been **validated** by: Sylvie Jacquot, PhD
Head of Genotyping Service

The first version of this report was finalized the: 08 Nov 2016

The last update of this report was done the: 08 Nov 2016

For any question, please contact:

PHENOMIN-ICS

Email: genotypingrequest@igbmc.fr

Web site: <http://www.ics-mci.fr/>



Table of contents

1. Genotyping protocol and data	3
1.1. Genotyping strategy	3
1.2. PCR protocol	5
2. Cre and Flp genotyping method	5



1. Genotyping protocol and data


This section describes the condition used at the Mouse Clinical Institute (ICS) to genotype your **Klf12** Constitutive Knockout / Conditional Knockout (KO-cKO x Cre) project.

1.1. Genotyping strategy

The map below describes the position of the primers used for genotyping for each possible allele.



KO-cKO pc _ Genotyping strategy

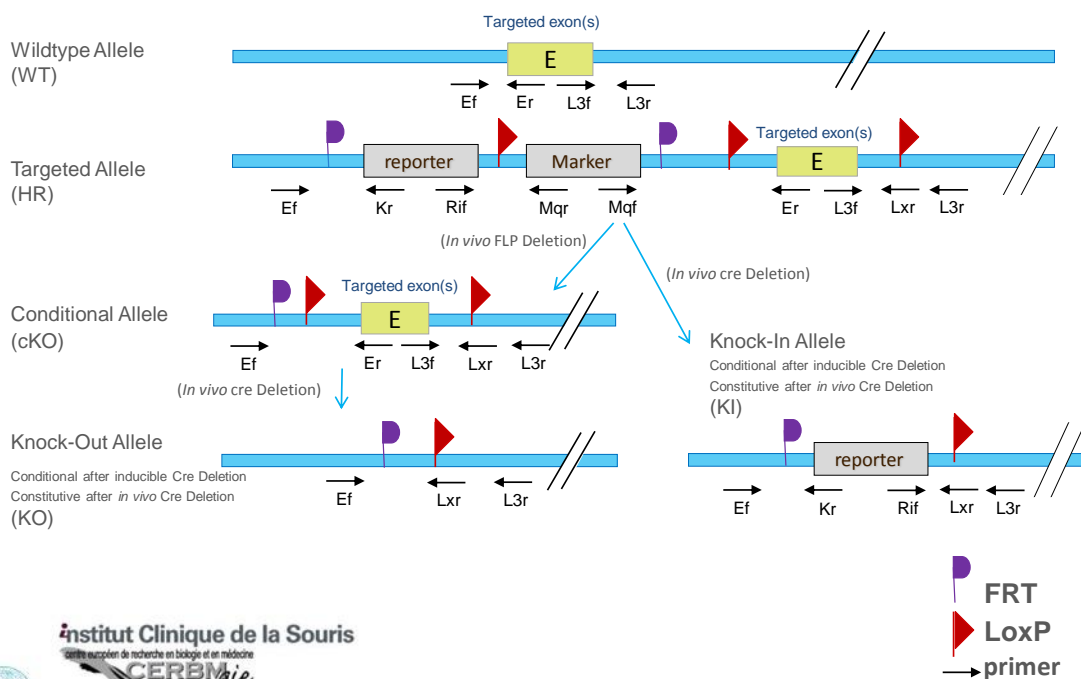

Sequence of primers used for genotyping:

Position	Primers	Sequence
Ef	9062	GTGTAGAAAGGTCACAGCGAGTTCCC
Ef ²	9063	CATTCACCGCAGTGTAGAACTCCAGAG
Er	9066	CACTGTTTCAGAACTGTGCAAACAGGAG
Kr	3277	CTCCTACATAGTTGGCAGTGTTGGG
L3f	9064	GGAGCCATGGCAAAGGTAAGAGAC
L3r	9065	GCTGTCTATCCCACCTTACCATTCAAAGG
Lxr	3255	ACTGATGGCGAGCTCAGACCATAAC
Ri1f	5966	GCACATGGCTGAATATCGACGGT

²: for a selected position, a second primer was designed

PCR fragments expected size (bp):

Region analyzed	Primers used	Position on the primer (see the map above)	Targeted allele (HR)	conditional allele (cKO)	KI allele	WildType allele
5' part of the selection marker	9062-3277	Ef / Kr	316	---	316	---
Presence of the distal loxP (with Betaine 0,5%)	9064-9065	L3f / L3r	316	316	---	320
Distal loxP specific PCR (with Betaine 0,5%)	9064-3255	L3f / Lxr	250	250	---	---
Excision of the selection marker	9063-9066	Ef ² / Er	7237*	333	---	175
Cre total excision	5966-3255	Ri1f / Lxr	3616*	---	471	---

*: this PCR product will not be observed using our PCR genotyping conditions (see description below)

---: no Amplicon should be obtained



1.2. PCR protocol

This section describes the composition of the mix and cycling conditions used for genotyping.

Reagents:	Volume:
- FastStart PCR Master (Roche)	7.5µl
- DNA (50ng/µl)	1.5µl
- 5' primer (100 µM)	0.06µl
- 3' primer (100 µM)	0.06µl
- Sterile H ₂ O	up to 15 µl

Cycling conditions:

Temp	Time	#Cycles
95°C	4min	1
94°C	30s	34
62°C	30s	
72°C	1min	
72°C	7min	1
20°C	5min	1

NB: These PCR conditions have been optimized for high-throughput genotyping. Adaptation to small-scale may be required.

2. Cre and Flp genotyping method

You will find the genotyping protocol in the publication:

[Highly-efficient, fluorescent, locus directed cre and FlpO deleter mice on a pure C57BL/6N genetic background.](#)

Birling MC, Dierich A, Jacquot S, Hérault Y, Pavlovic G.
Genesis. 2012 Jun;50(6):482-9. doi: 10.1002/dvg.20826. Epub 2012 Mar 20.

