

Genotyping protocol

Project Bace2

(PHENOMIN-ICS reference IR00006046 / P6046)

This report has been **prepared** by: Christelle MORGENTHALER-ROTH

This report has been **validated** by: Sylvie Jacquot, PhD
Head of Genotyping Service

The first version of this report was finalized the: 23 Mar 2017

The last update of this report was done the: 23 Mar 2017

For any question, please contact:

PHENOMIN-ICS
Email: genotypingrequest@igbmc.fr
Web site: <http://www.ics-mci.fr/>



1 rue Laurent Fries, BP 10142, 67404 Illkirch Cedex, France

Table of contents

1. Genotyping protocol and data	3
1.1. Genotyping strategy.....	3
1.2. PCR protocol.....	Erreur ! Signet non défini.
2. Cre and Flp genotyping method.....	5




1. Genotyping protocol and data

This section describes the condition used at the Mouse Clinical Institute (ICS) to genotype your **Bace2** Constitutive Knockout / Conditional Knockout (KO-cKO x Cre) project.

1.1. Genotyping strategy

The map below describes the position of the primers used for genotyping for each possible allele.

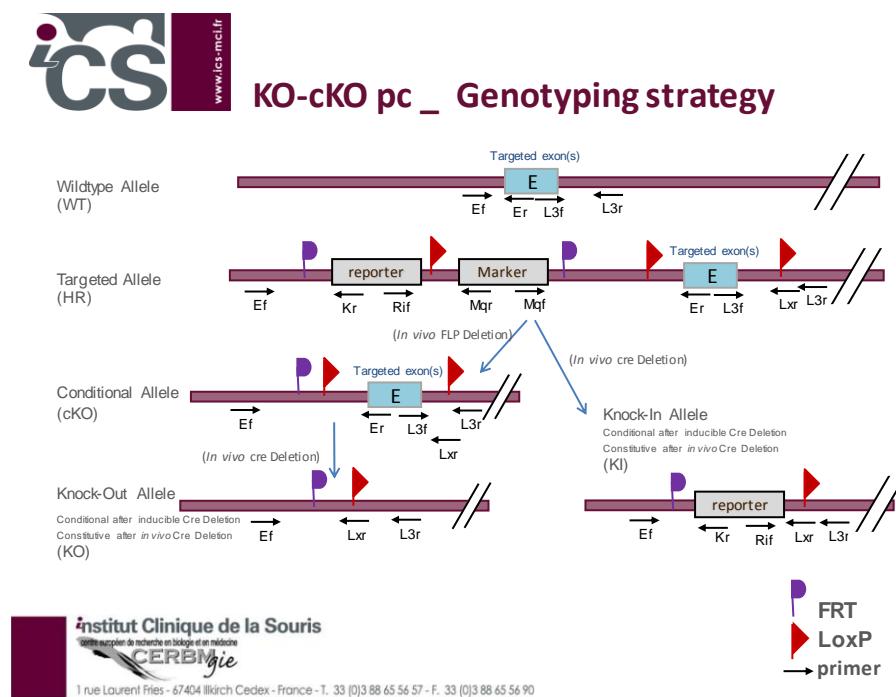

Sequence of primers used for genotyping:

Position	Primers	Sequence
Ef	9526	CCTCAGCACTTACACACGTGCAAGG
Er	9529	CTACATCATTTCTGGACACCACATCTGG
Kr	3278	GGGCAAGAACATAAAGTGACCCCTCC
L3f	9527	CCTTGGACTTGCTTATGCTGCTTG
L3r	9528	GAAATTACCCCTAGCTGCAAATGTGCCT
Lxr	3255	ACTGATGGCGAGCTCAGACCATAAC
Ri1f	5966	GCACATGGCTGAATATGACGGT

PCR fragments expected size (bp):

Region analyzed	Primers used	Position on the primer <i>(see the map above)</i>	Targeted allele (HR)	conditional allele (cKO)	KO allele	WildType allele
5' part of the selection marker	9526-3278	Ef / Kr	381	---	---	---
Presence of the distal loxP	9527-9528	L3f / L3r	280	280	---	217
Distal loxP specific PCR	9527-3255	L3f / Lxr	241	241	---	---
Excision of the selection marker	9526-9529	Ef / Er	7365*	461	---	325
Cre total excision	5966-3255	Ri1f / Lxr	3256*	---	---	---

*: this PCR product will not be observed using our PCR genotyping conditions (see description below)

---: no Amplicon should be obtained



1.2. PCR protocol

This section describes the composition of the mix and cycling conditions used for genotyping.

Reagents:	Volume:
- FastStart PCR Master (Roche)	7.5µl
- DNA (50ng/µl)	1.5µl
- 5' primer (100 µM)	0.06µl
- 3' primer (100 µM)	0.06µl
- Sterile H ₂ O	up to 15 µl

Cycling conditions:		
Temp	Time	#Cycles
95°C	4min	1
94°C	30s	
62°C	30s	34
72°C	1min	
72°C	7min	1
20°C	5min	1

NB: These PCR conditions have been optimized for high-throughput genotyping. Adaptation to small-scale may be required.

2. Cre and Flp genotyping method

You will find the genotyping protocol in the publication:

[Highly-efficient, fluorescent, locus directed cre and FlpO deleter mice on a pure C57BL/6N genetic background.](#)

Birling MC, Dierich A, Jacquot S, Héault Y, Pavlovic G.
Genesis. 2012 Jun;50(6):482-9. doi:10.1002/dvg.20826. Epub 2012 Mar 20.

