



Genotyping protocol

Ascc3 (IR00003015 / E189 ICS internal reference)

Ascc3 (IR00003015 / E189 ICS internal reference) mouse line genotyping protocol

Table of contents

Table of contents	1
Genotyping protocol and data	2
1. Genotyping strategy	2
2. PCR protocol	3
3. Picture of genotyping with various alleles	4

For any question, please contact:

Mouse Clinical Institute – Institut Clinique de la Souris (ICS)

ICS genotyping service

1 rue Laurent Fries, BP 10142

67404 Illkirch Cedex France

Email: mutagenesis@igbmc.fr


This protocol has been validated by Valérie Rousseau.

Genotyping protocol and data

This section describes the condition used at the Mouse Clinical Institute (ICS) to genotype your **Ascc3** Constitutive Knockout / Conditional Knockout (KO-cKO) project.

1. Genotyping strategy

The map below describes the position of the primers used for genotyping for each possible allele.

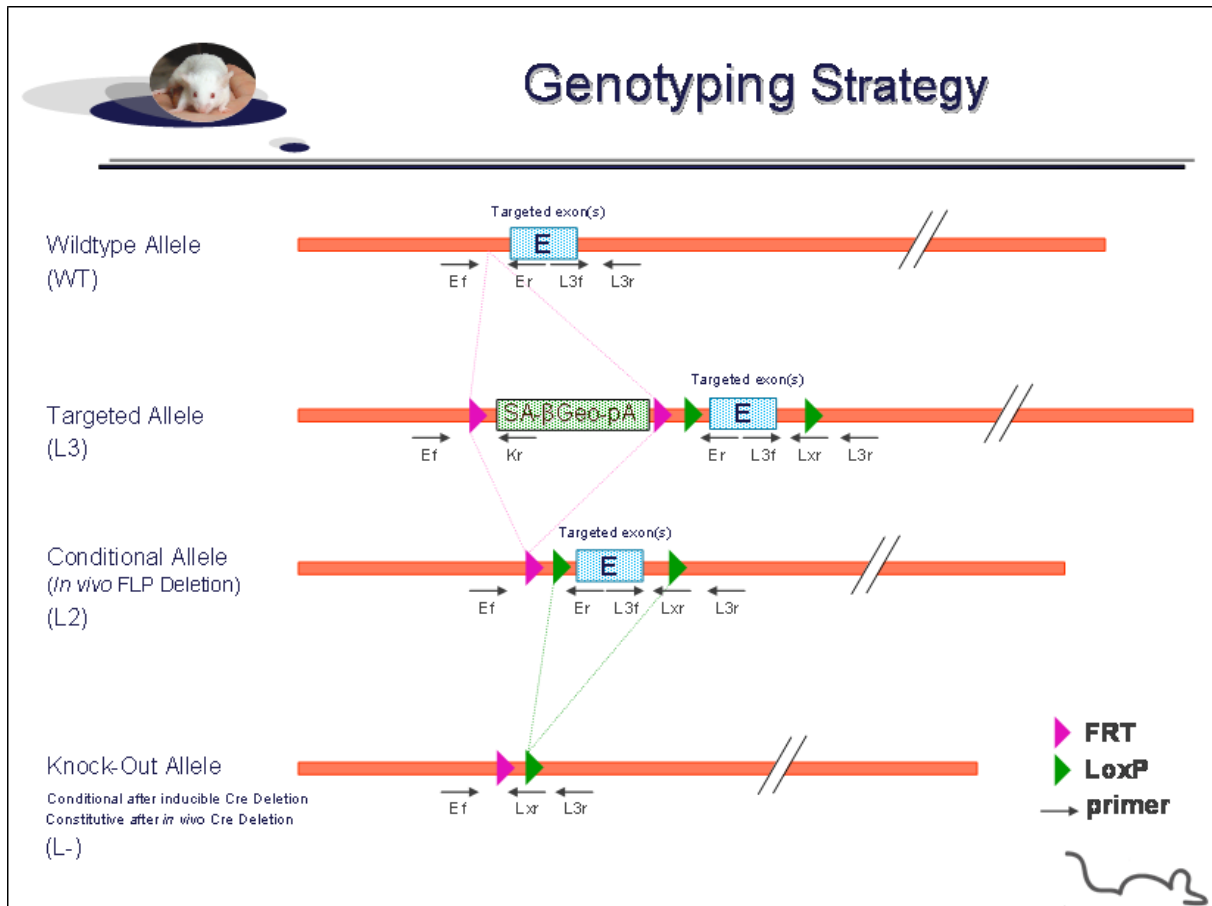

Sequence of primers used for genotyping

Position	Primers	Sequence
Ef	5453	GAGCCATCTCACCAGCCCTTCCTT
Ef	5454	CTTGTTATGGATGGTTGTGCGCC
Er	5458	GCATGAAAGTCAGGTGACCTCACACAC
Kr	3209	CCAACAGCTTCCCCACAACGG
L3f	5455	GCTTCTGCTAAAAGCGGCGATGAA
L3f	5456	AGGACGAGGTACCGTTGAAGTTTCTCA
L3r	5457	GCCCCAAAACCTTTTCTAAAAGTCAGCT
Lxr	3255	ACTGATGGCGAGCTCAGACCATAAC



Genotyping protocol

Ascc3 (IR00003015 / E189 ICS internal reference)

PCR fragments expected size (bp):

Region analyzed	Primers used	Position on the primer (see the map above)	Targeted allele (KO allele) (L3)	cKO allele (L2)	KO allele (L-)	WildType allele (WT)
5' part of the selection marker	5453-3209	Ef / Kr	328	---	---	---
Presence of the distal loxP	5455-5457	L3f / L3r	563	563**	---	527
Distal loxP specific PCR	5456-3255	L3f / Lxr	276	276**	---	---
Excision of the selection marker	5453-5458	Ef / Er	7298*	394**	---	233
Excision of the floxed exon(s), i.e. knock out	5454-5457	Ef / L3r	8809*	1905*	630**	1708**

* This PCR product will not be observed using our PCR genotyping conditions (see description below)

** This PCR is only verified if mice are generated

--- No Amplicon should be obtained

2. PCR protocol

This section describes the composition of the mix and cycling conditions used for genotyping.

Reagents:

- FastStart PCR Master (Roche)
- DNA (50ng/μl)
- 5' primer (100 μM)
- 3' primer (100 μM)
- Sterile H₂O

Volume:

- 7.5μl
- 1.5μl
- 0.06μl
- 0.06μl
- up to 15 μl

Cycling conditions:


Temp	Time	#Cycles
95°C	4min	1
94°C	30s	34
62°C	30s	
72°C	1min	
72°C	7min	1
20°C	5 min	1

NB: These PCR conditions have been optimized for high-throughput genotyping. Adaptation to small-scale may be required.

3. Picture of genotyping with various alleles

Analysis of PCR products pattern was not done by gel electrophoresis but using LabChip® 90 microfluidic apparatus. PCR products were run on the HT DNA 5K LabChip® 90 Assay Kit.

Representative genotyping picture

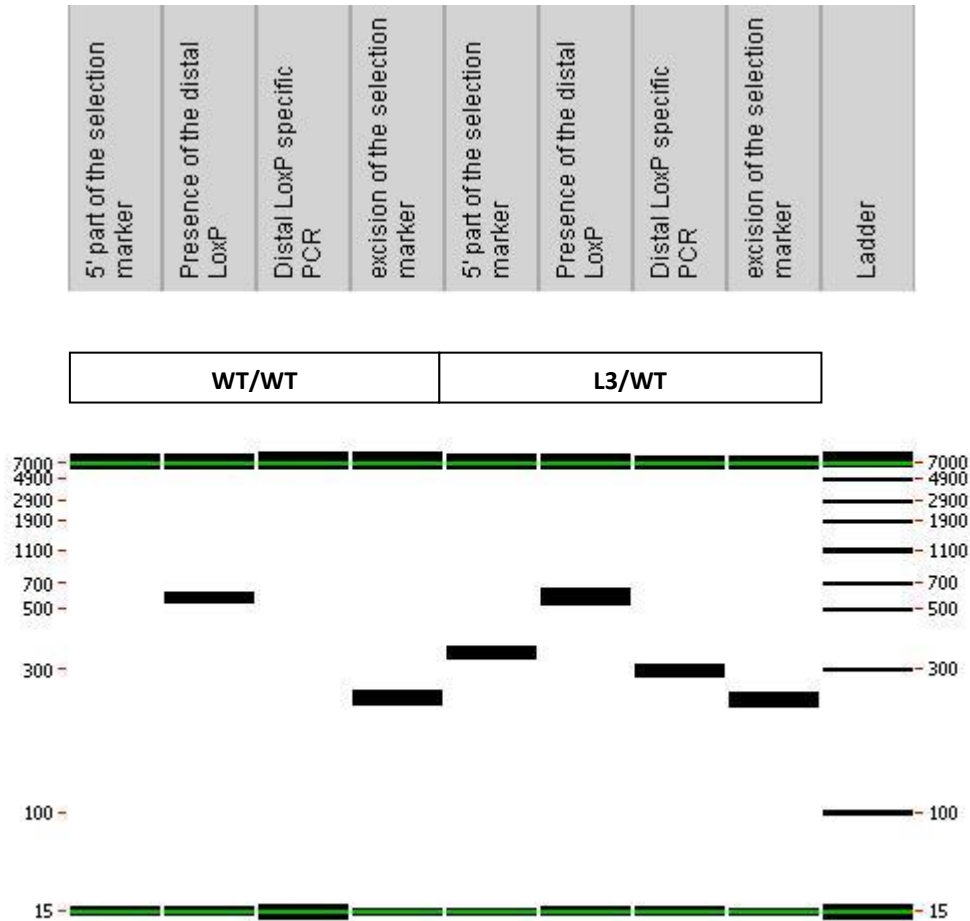

Note that as this technology is more sensitive than gel analysis, non specific signals and/or primer dimers may be visible on the picture.